

# WERTZ CONSTRUCTION

## Radon Inspection Report

### Measurement Information

Client Name  
wertz

Building Year  
1973

Measurement Started  
11/10/2023 13:00


Building Type  
House

Measurement Ended  
11/12/2023 13:02

Room Type  
Bedroom

Inspection Duration  
48 hour (Data No: 48)

Floor  
Basement



Measurement Location  
88 sunset dr  
Hanover, , Pennsylvania 17331

Test Result: **< EPA Guidelines**

Overall Average  
**3.9 pCi/L**

EPA Average\*  
**4.0 pCi/L**

Note: The EPA average excludes the first 4 hours of data to follow EPA Protocol

### Radon Levels Guide



### Device Information

Device S/N  
RP22204260061

Device Calibrated  
07/19/2023

### Tester Information

Tester Name  
Lewis Wertz

Tester Email  
wertzconst4@gmail.com

Tester Address  
88 Sunset Dr. Hanover Pa. 17331  
Hanover, Pennsylvania 17331

Certification # (State-License #)

Tester Phone  
4432535428

# Inspection Information

Delay Time  
0 hour

Measured Radon Concentration Max  
5.7 pCi/L


Inspection Duration  
48 hours

Measured Radon Concentration Min  
2.2 pCi/L

Measurement Started  
11/10/2023 13:00

Measurement Ended  
11/12/2023 13:02

## Historical Radon Trend

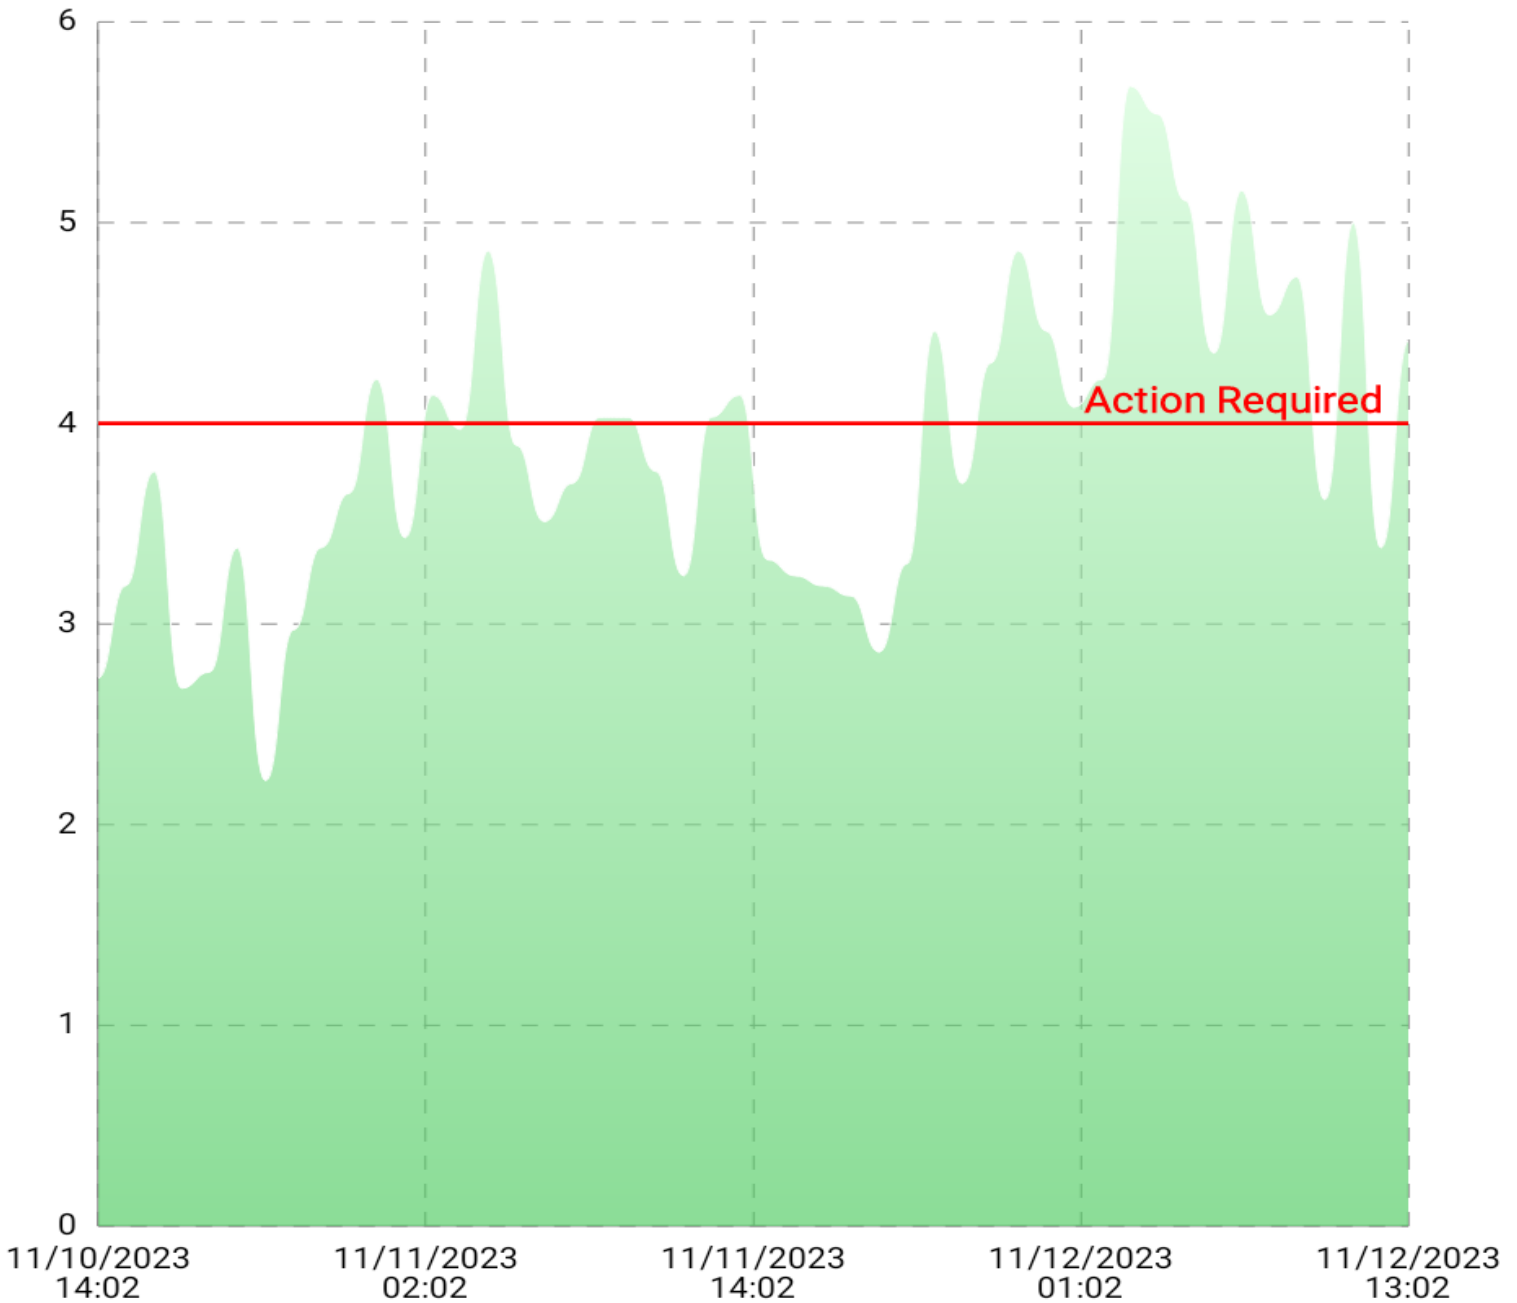

## Table of Hourly Radon Measurements

**Radon Concentration Average:**  
**3.9 pCi/L**

Timestamp	Radon Value	Temp (F)	RH(%)	Timestamp	Radon Value	Temp (F)	RH(%)
11/10/23 14:02	2.7	72	45	11/11/23 14:02	3.3	72	35
11/10/23 15:02	3.2	71	42	11/11/23 15:02	3.2	73	35
11/10/23 16:02	3.8	73	41	11/11/23 16:02	3.2	71	35
11/10/23 17:02	2.7	73	39	11/11/23 17:02	3.1	72	35
11/10/23 18:02	2.8	71	39	11/11/23 18:02	2.9	72	36
11/10/23 19:02	3.4	71	40	11/11/23 19:02	3.3	72	35
11/10/23 20:02	2.2	72	38	11/11/23 20:02	4.5	71	36
11/10/23 21:02	3.0	72	39	11/11/23 21:02	3.7	72	35
11/10/23 22:02	3.4	72	37	11/11/23 22:02	4.3	71	35
11/10/23 23:02	3.6	73	37	11/11/23 23:02	4.9	72	35
11/11/23 00:02	4.2	71	37	11/12/23 00:02	4.5	73	35
11/11/23 01:02	3.4	72	36	11/12/23 01:02	4.1	71	35
11/11/23 02:02	4.1	72	36	11/12/23 02:02	4.2	72	34
11/11/23 03:02	4.0	71	36	11/12/23 03:02	5.7	72	34
11/11/23 04:02	4.9	72	36	11/12/23 04:02	5.5	71	34
11/11/23 05:02	3.9	72	36	11/12/23 05:02	5.1	71	34
11/11/23 06:02	3.5	71	35	11/12/23 06:02	4.4	72	33
11/11/23 07:02	3.7	72	35	11/12/23 07:02	5.2	71	33
11/11/23 08:02	4.0	71	36	11/12/23 08:02	4.5	71	33
11/11/23 09:02	4.0	71	35	11/12/23 09:02	4.7	72	33
11/11/23 10:02	3.8	72	35	11/12/23 10:02	3.6	71	33
11/11/23 11:02	3.2	72	36	11/12/23 11:02	5.0	71	33
11/11/23 12:02	4.0	72	35	11/12/23 12:02	3.4	73	32
11/11/23 13:02	4.1	72	36	11/12/23 13:02	4.4	71	33

\* Temperature and humidity can vary depending on environmental conditions.

\* The test data was taken from a testing device approved by the National Radon Proficiency Program.

## Table of Hourly Radon Measurements

Radon Concentration Average:  
3.9 pCi/L

Timestamp	Radon Value	Temp (F)	RH(%)	Timestamp	Radon Value	Temp (F)	RH(%)
Event							
Movement	11/10/2023 15:26						

\* Temperature and humidity can vary depending on environmental conditions.

\* The test data was taken from a testing device approved by the National Radon Proficiency Program.

## Measurement Environment



